



TXV Installation Recommendations

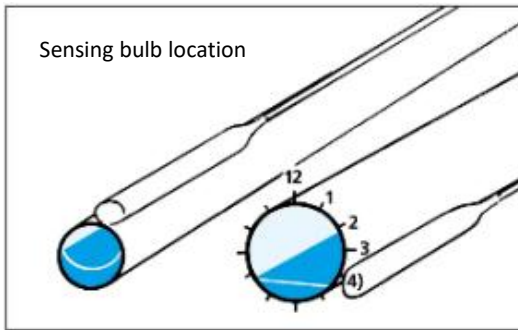

The temp. sensing bulb should be installed on the horizontal suction pipe, and the position should be at 1 o'clock and 4 o'clock position. Position depends on tubing OD.

Pay Attention: The sensing bulb should never be at the bottom of the suction line as oil at the bottom may give false signals.

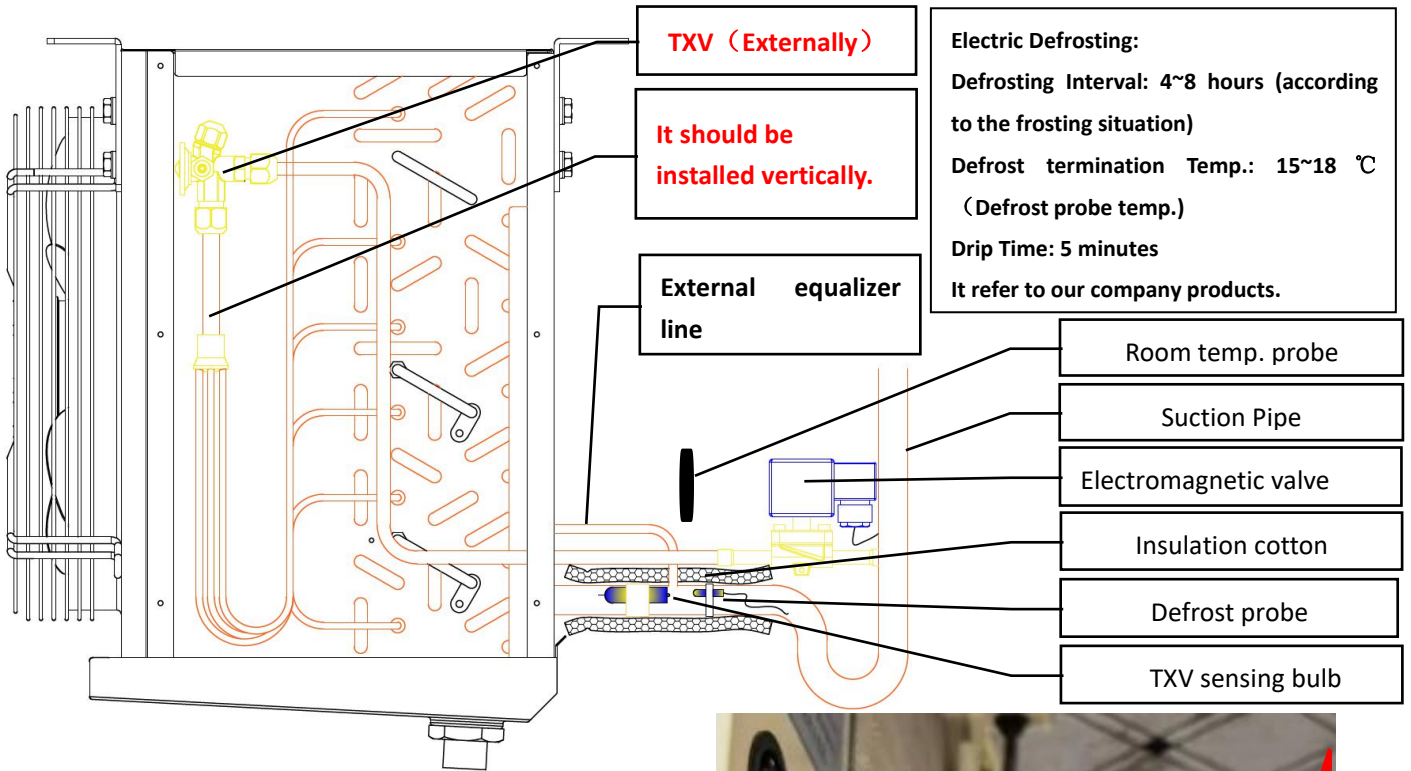