


How to Install the Ceiling Mounted Refrigeration Unit?

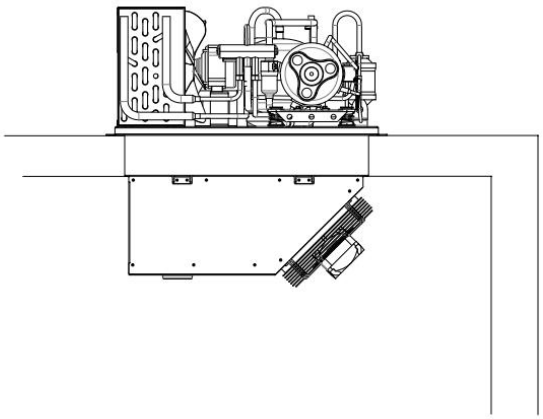

- The monoblock refrigeration unit is mounted on the roof panel of the cold room or freezer room.
- Prepare a opening with suitable dimensions in the cold room roof panel (see pictures).
- The L2 and W2 is the opening dimension.
- Position the unit onto the cold room roof panel inserting the evaporator section in the opening.
- Fix the unit using the screws supplied.

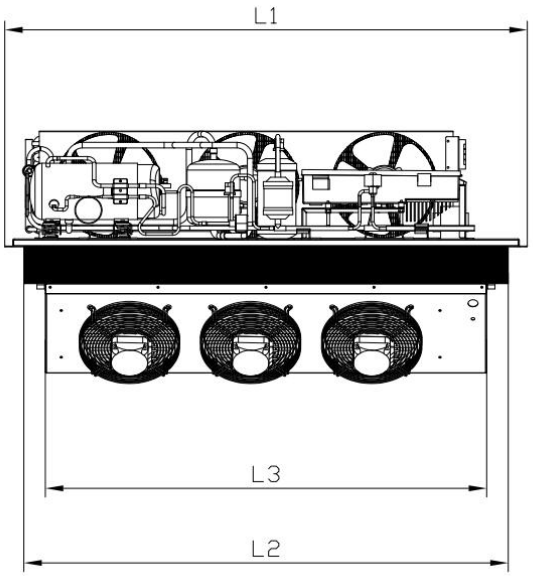

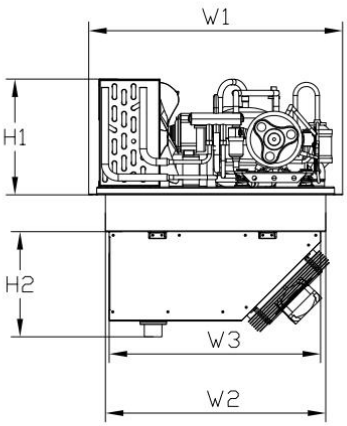

Unit:mm

Model	L1	L2	L3	W1	W2	W3	H1	H2
GL-BYTDN10EL	990	910	762	552	450	400	265	225
GL-BYTDN20EL	1190	1100	1002	580	500	480	265	225
GL-BYTDN30EL	1350	1270	1152	610	530	510	265	265

Note: The opening size of the panel for the unit is: L2*W2.